





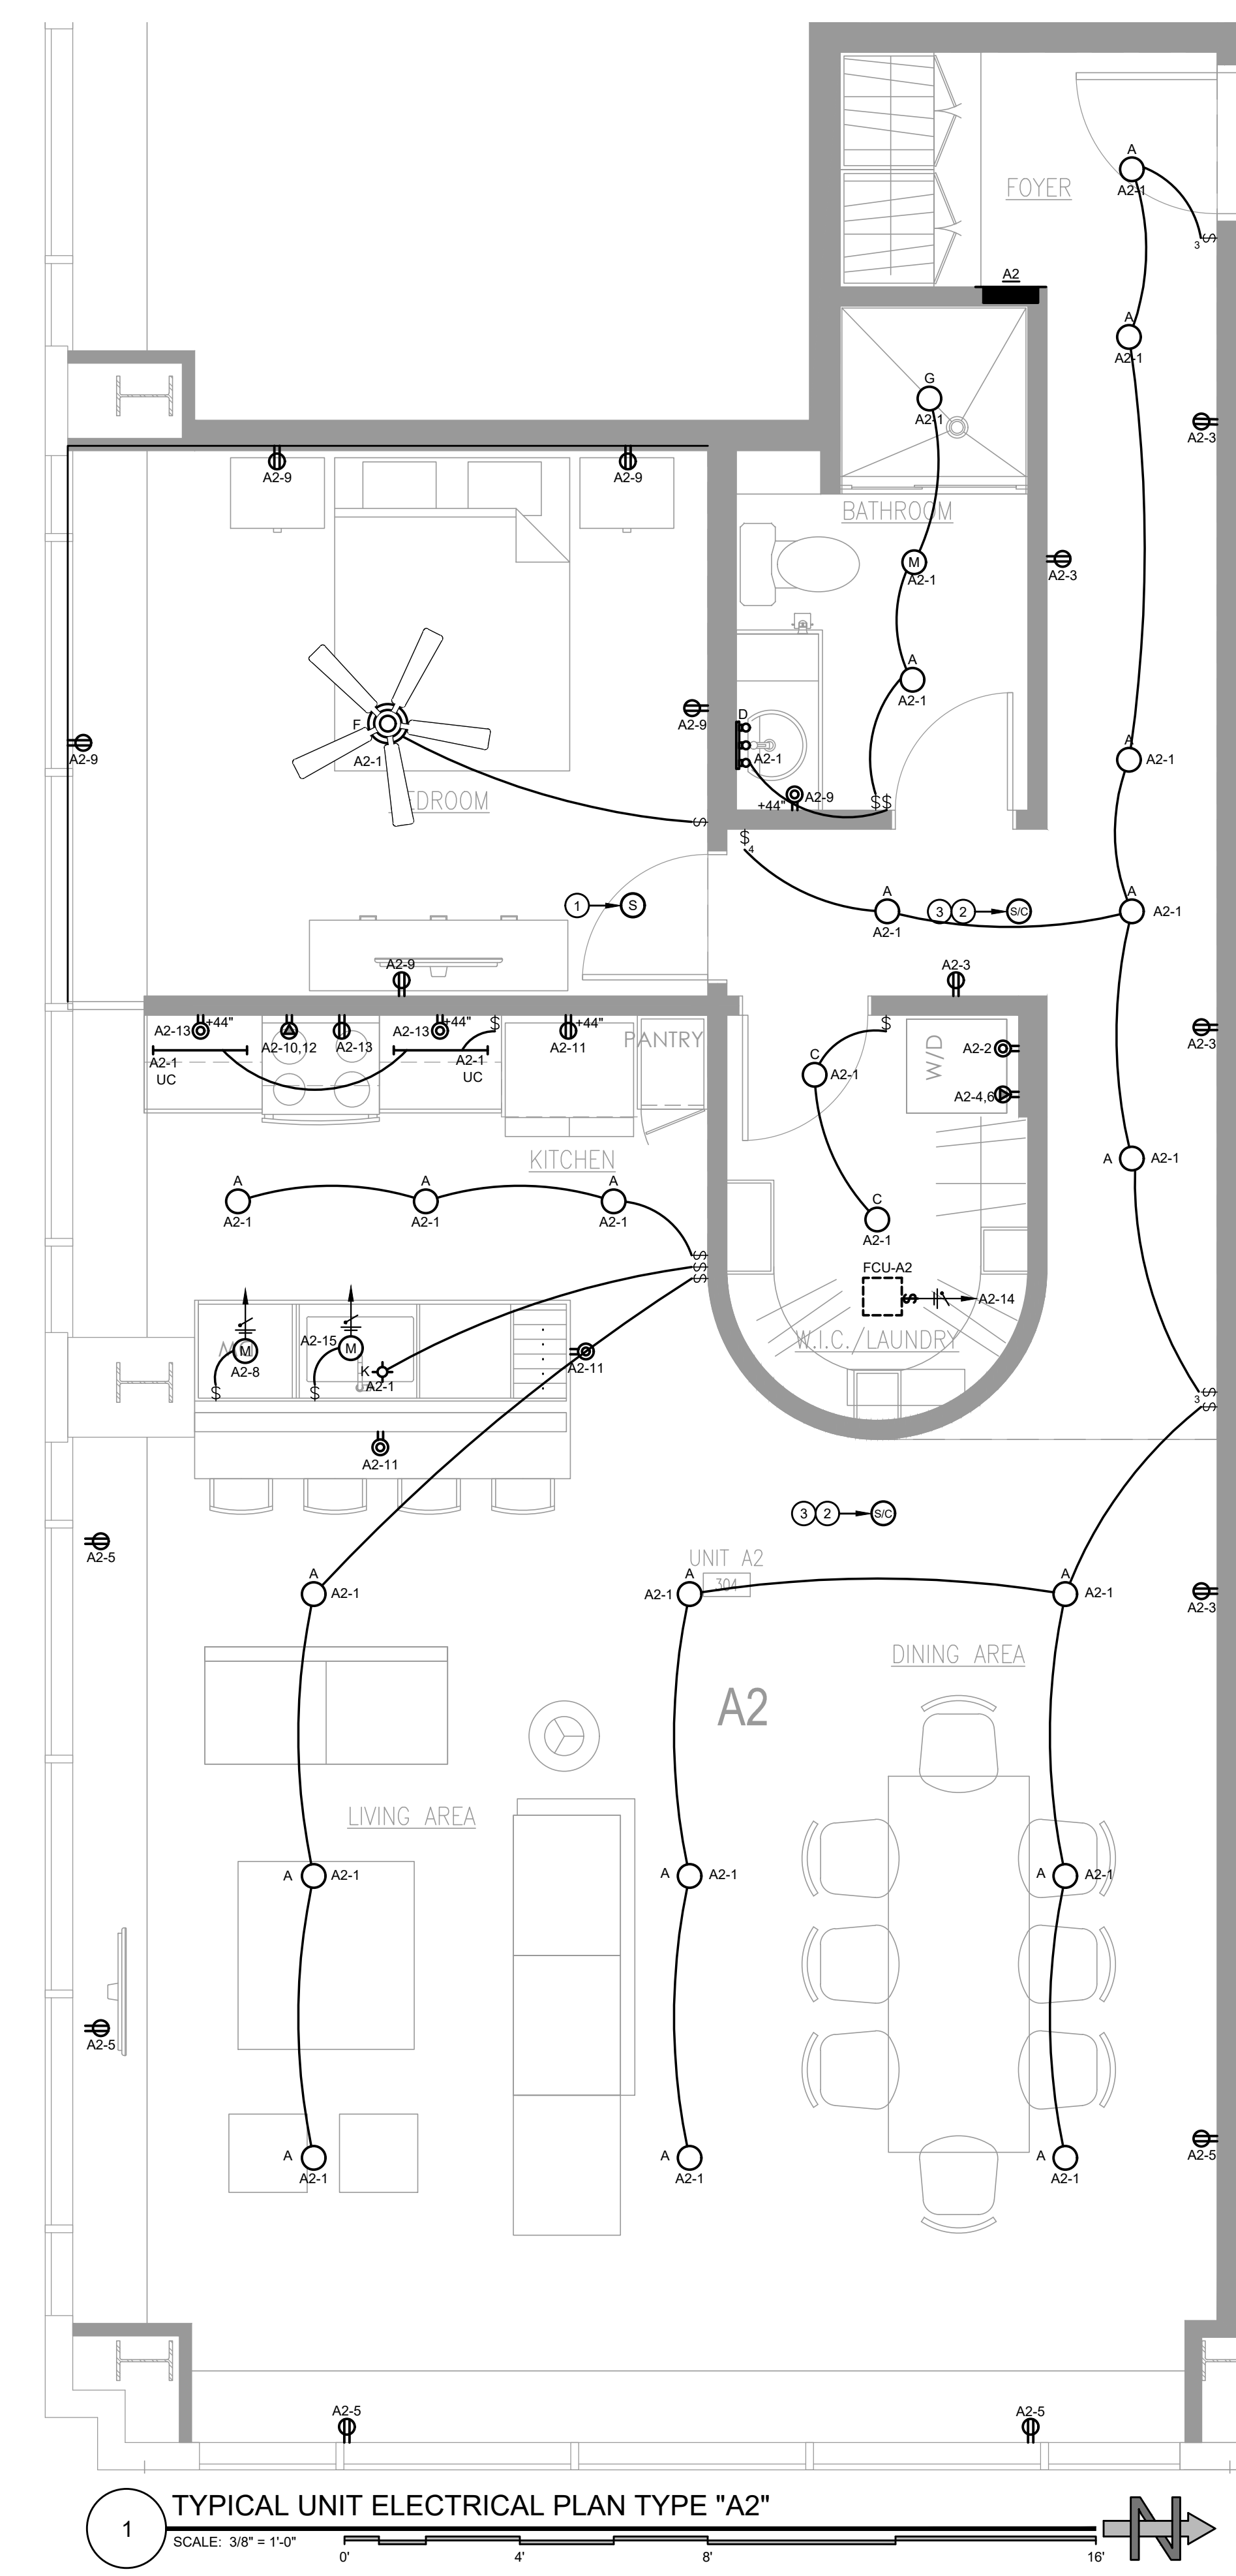

PLAN NOTES	
1	PROVIDE DUAL SENSING (PHOTOELECTRIC AND IONIZATION) SMOKE DETECTOR AT THIS LOCATION. ALL SMOKE DETECTORS SHALL BE 120V HARD WIRED AND INTERCONNECTED WITH BATTERY BACKUP.
2	PROVIDE WITH DUAL SENSING (PHOTOELECTRIC AND IONIZATION) SMOKE DETECTOR WITH CARBON MONOXIDE SENSOR AT THIS LOCATION. ALL SMOKE DETECTORS SHALL BE 120V HARD-WIRED AND INTERCONNECTED WITH BATTERY BACKUP.
3	CONTRACTOR TO INSTALL MULTI-STATION SMOKE DETECTORS AND COMBINATION SMOKE/CARBON MONOXIDE DETECTORS IN ACCORDANCE WITH NFPA 72. TYPICAL OF ALL DEVICES.

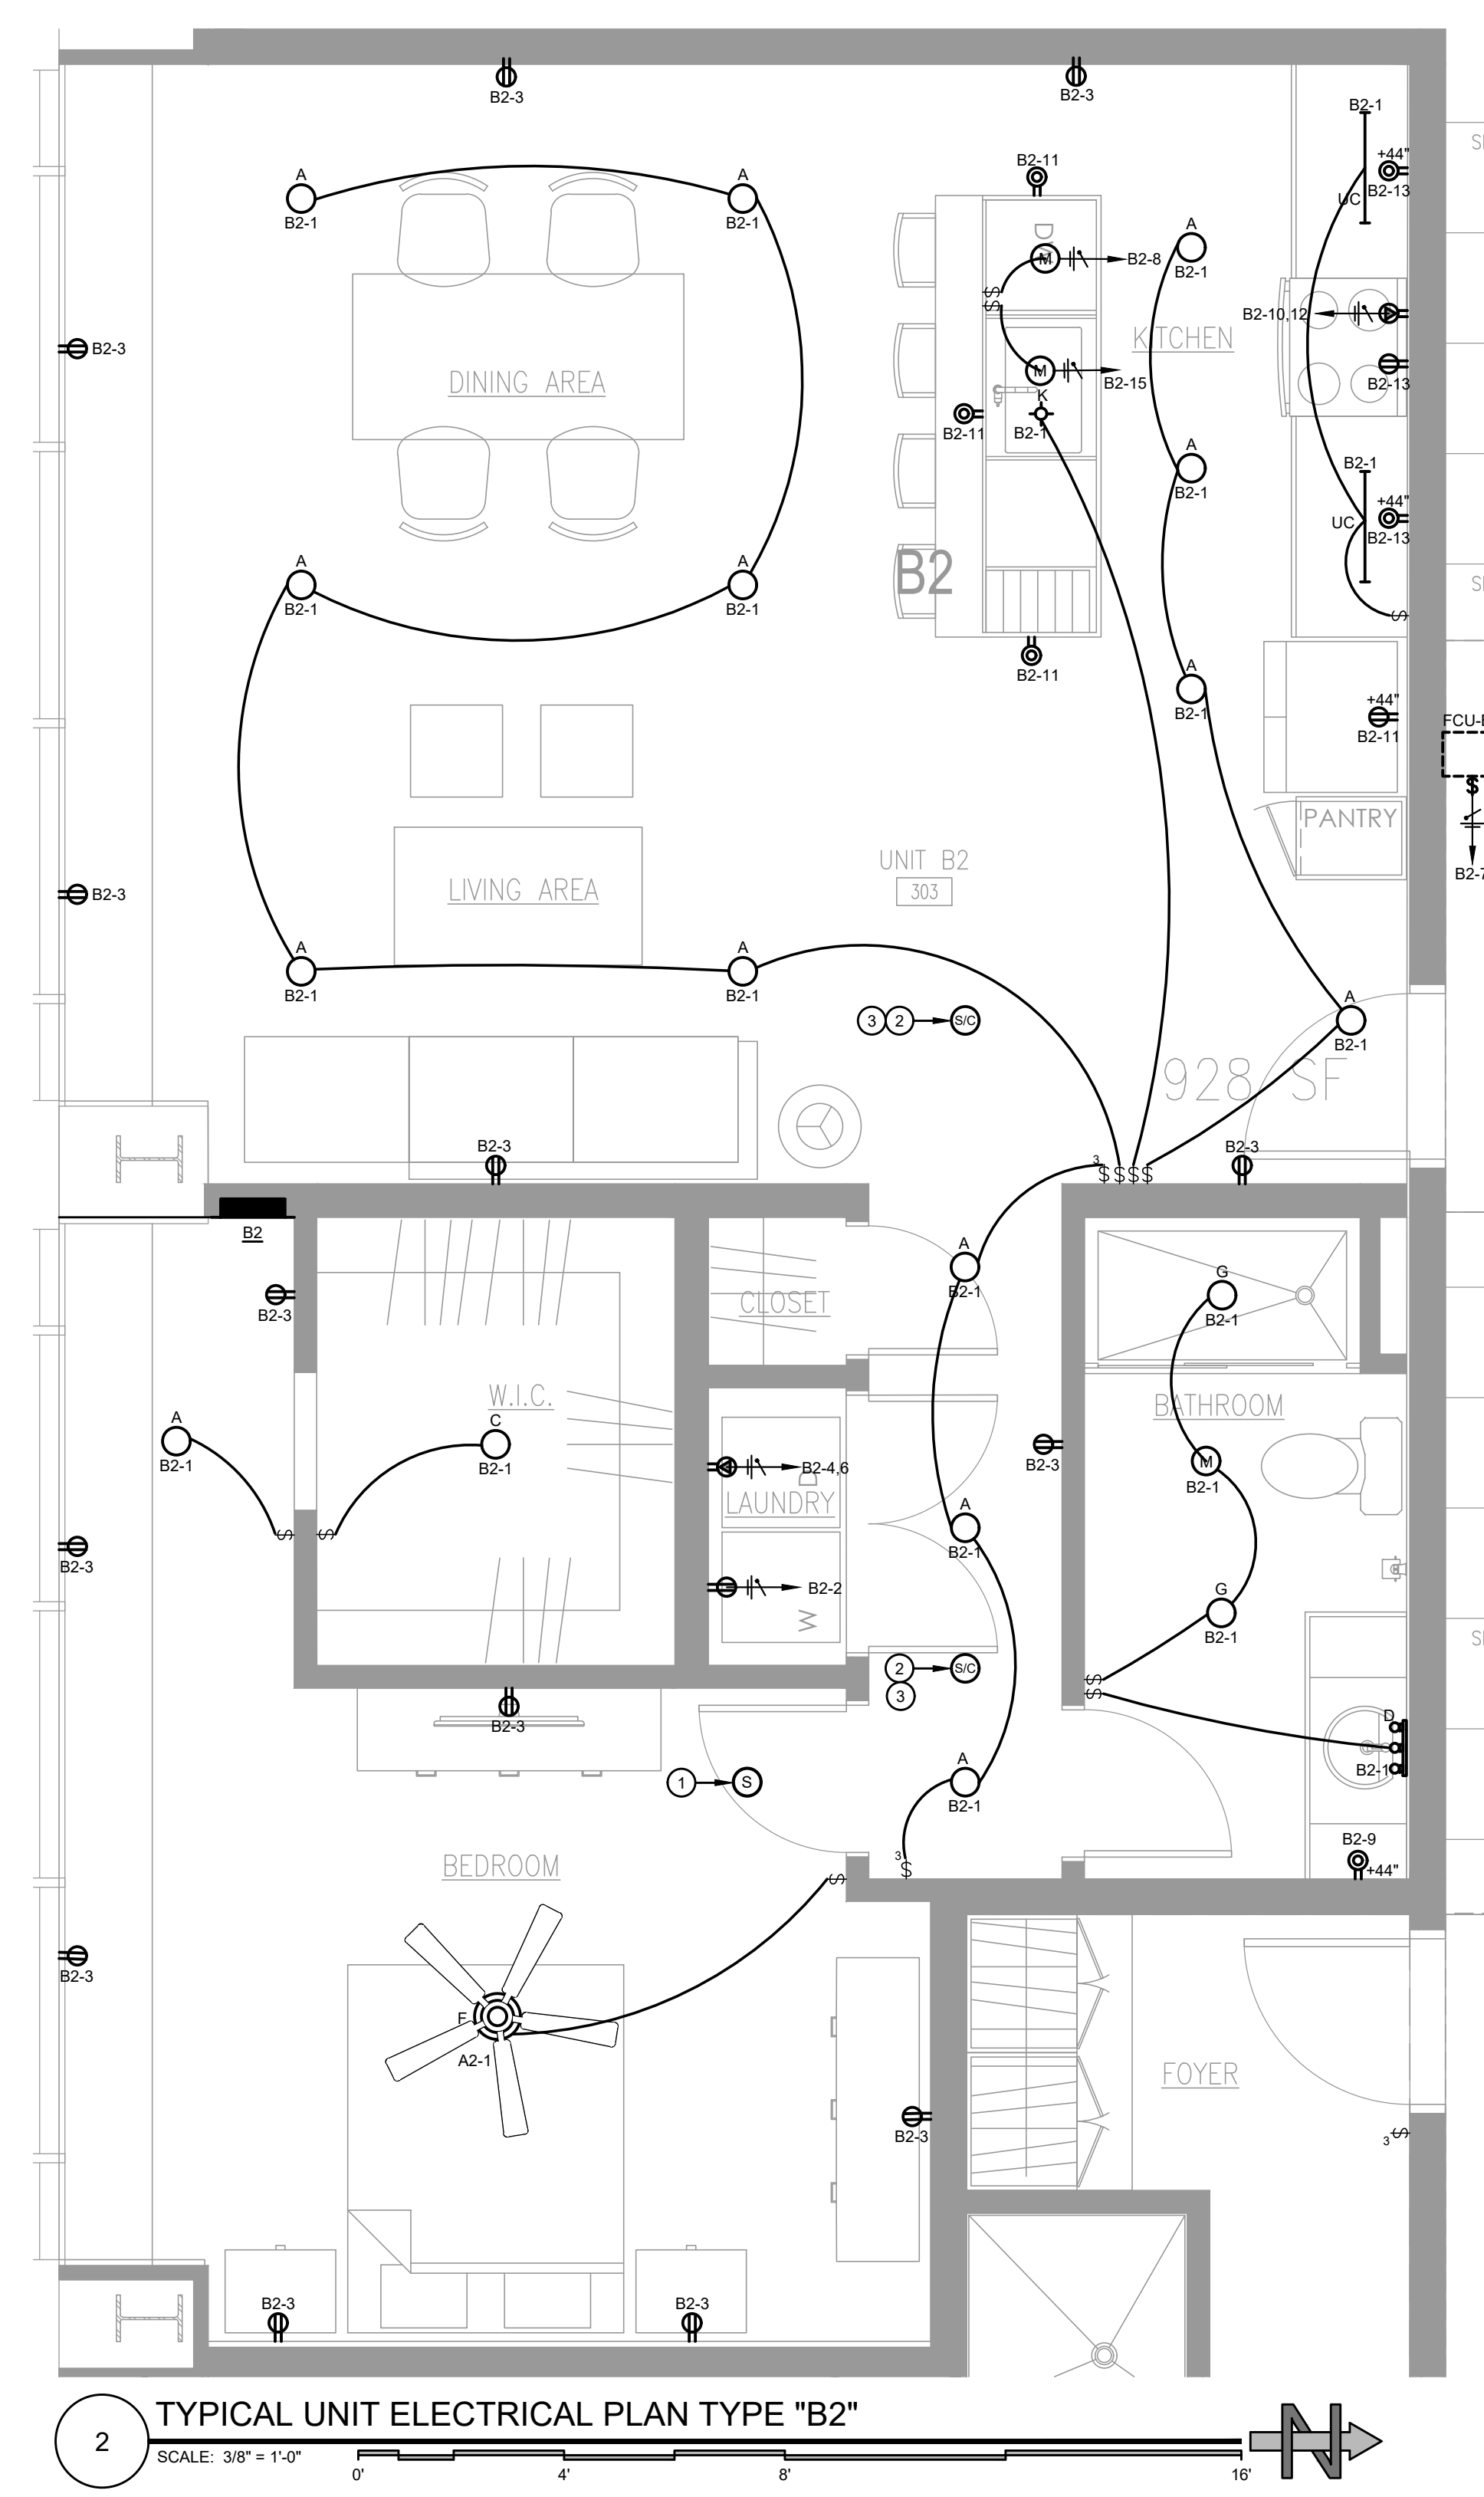

NO.	DATE	ISSUED FOR

SEAL


*Sam S. Agre*  
SIGNATURE

DATE


TYPICAL UNIT ELECTRICAL PLAN	
DRAWN BY:	SJG, AGR
CHECKED BY:	SJG
SCALE:	AS NOTED
JOB NUMBER:	57640
START DATE:	11/02/2022

PLotted by EJM CO-OP/PT on Tuesday, August 22, 2023 9:28:01 AM. FILE LOCATION: Y:\0 PROJECTS\CURRENT 2022\MOEL GROUP\MERCANTILE LIBRARY\WORKING FLESH\FORMICA BUILDINGSHEETS-E1.11.DWG



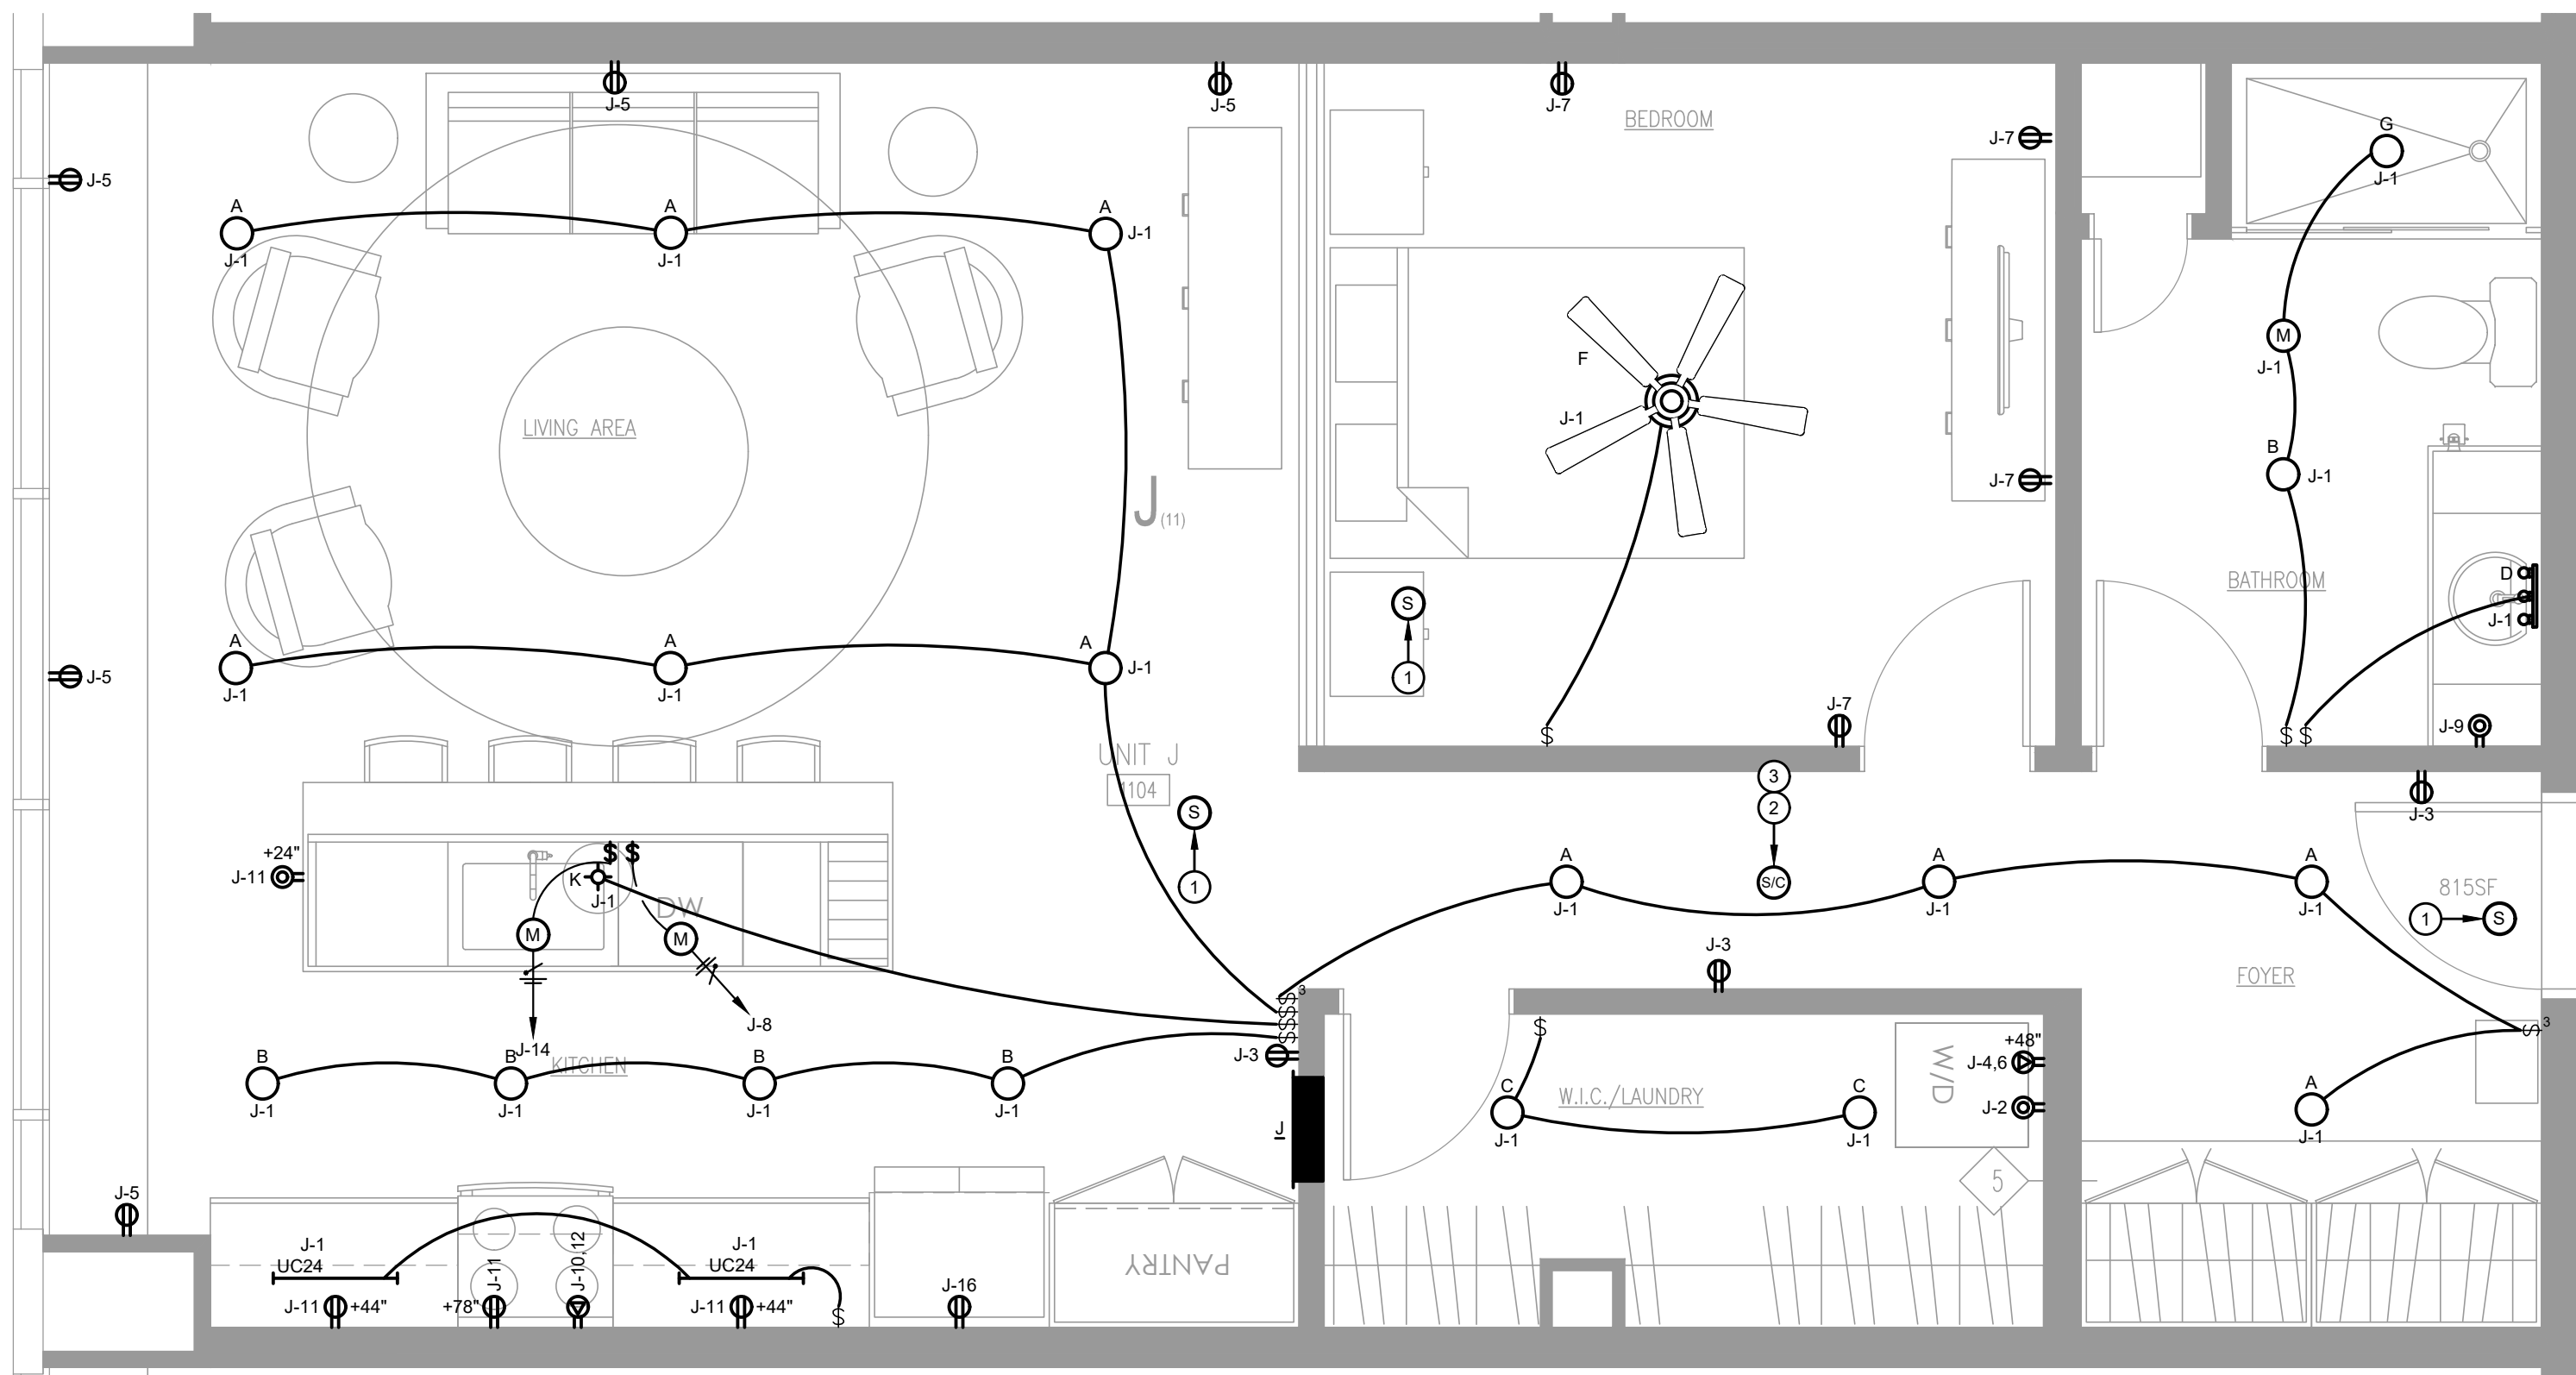


2 TYPICAL UNIT ELECTRICAL PLAN TYPE "J"  
SCALE: 3/8" = 1'-0"

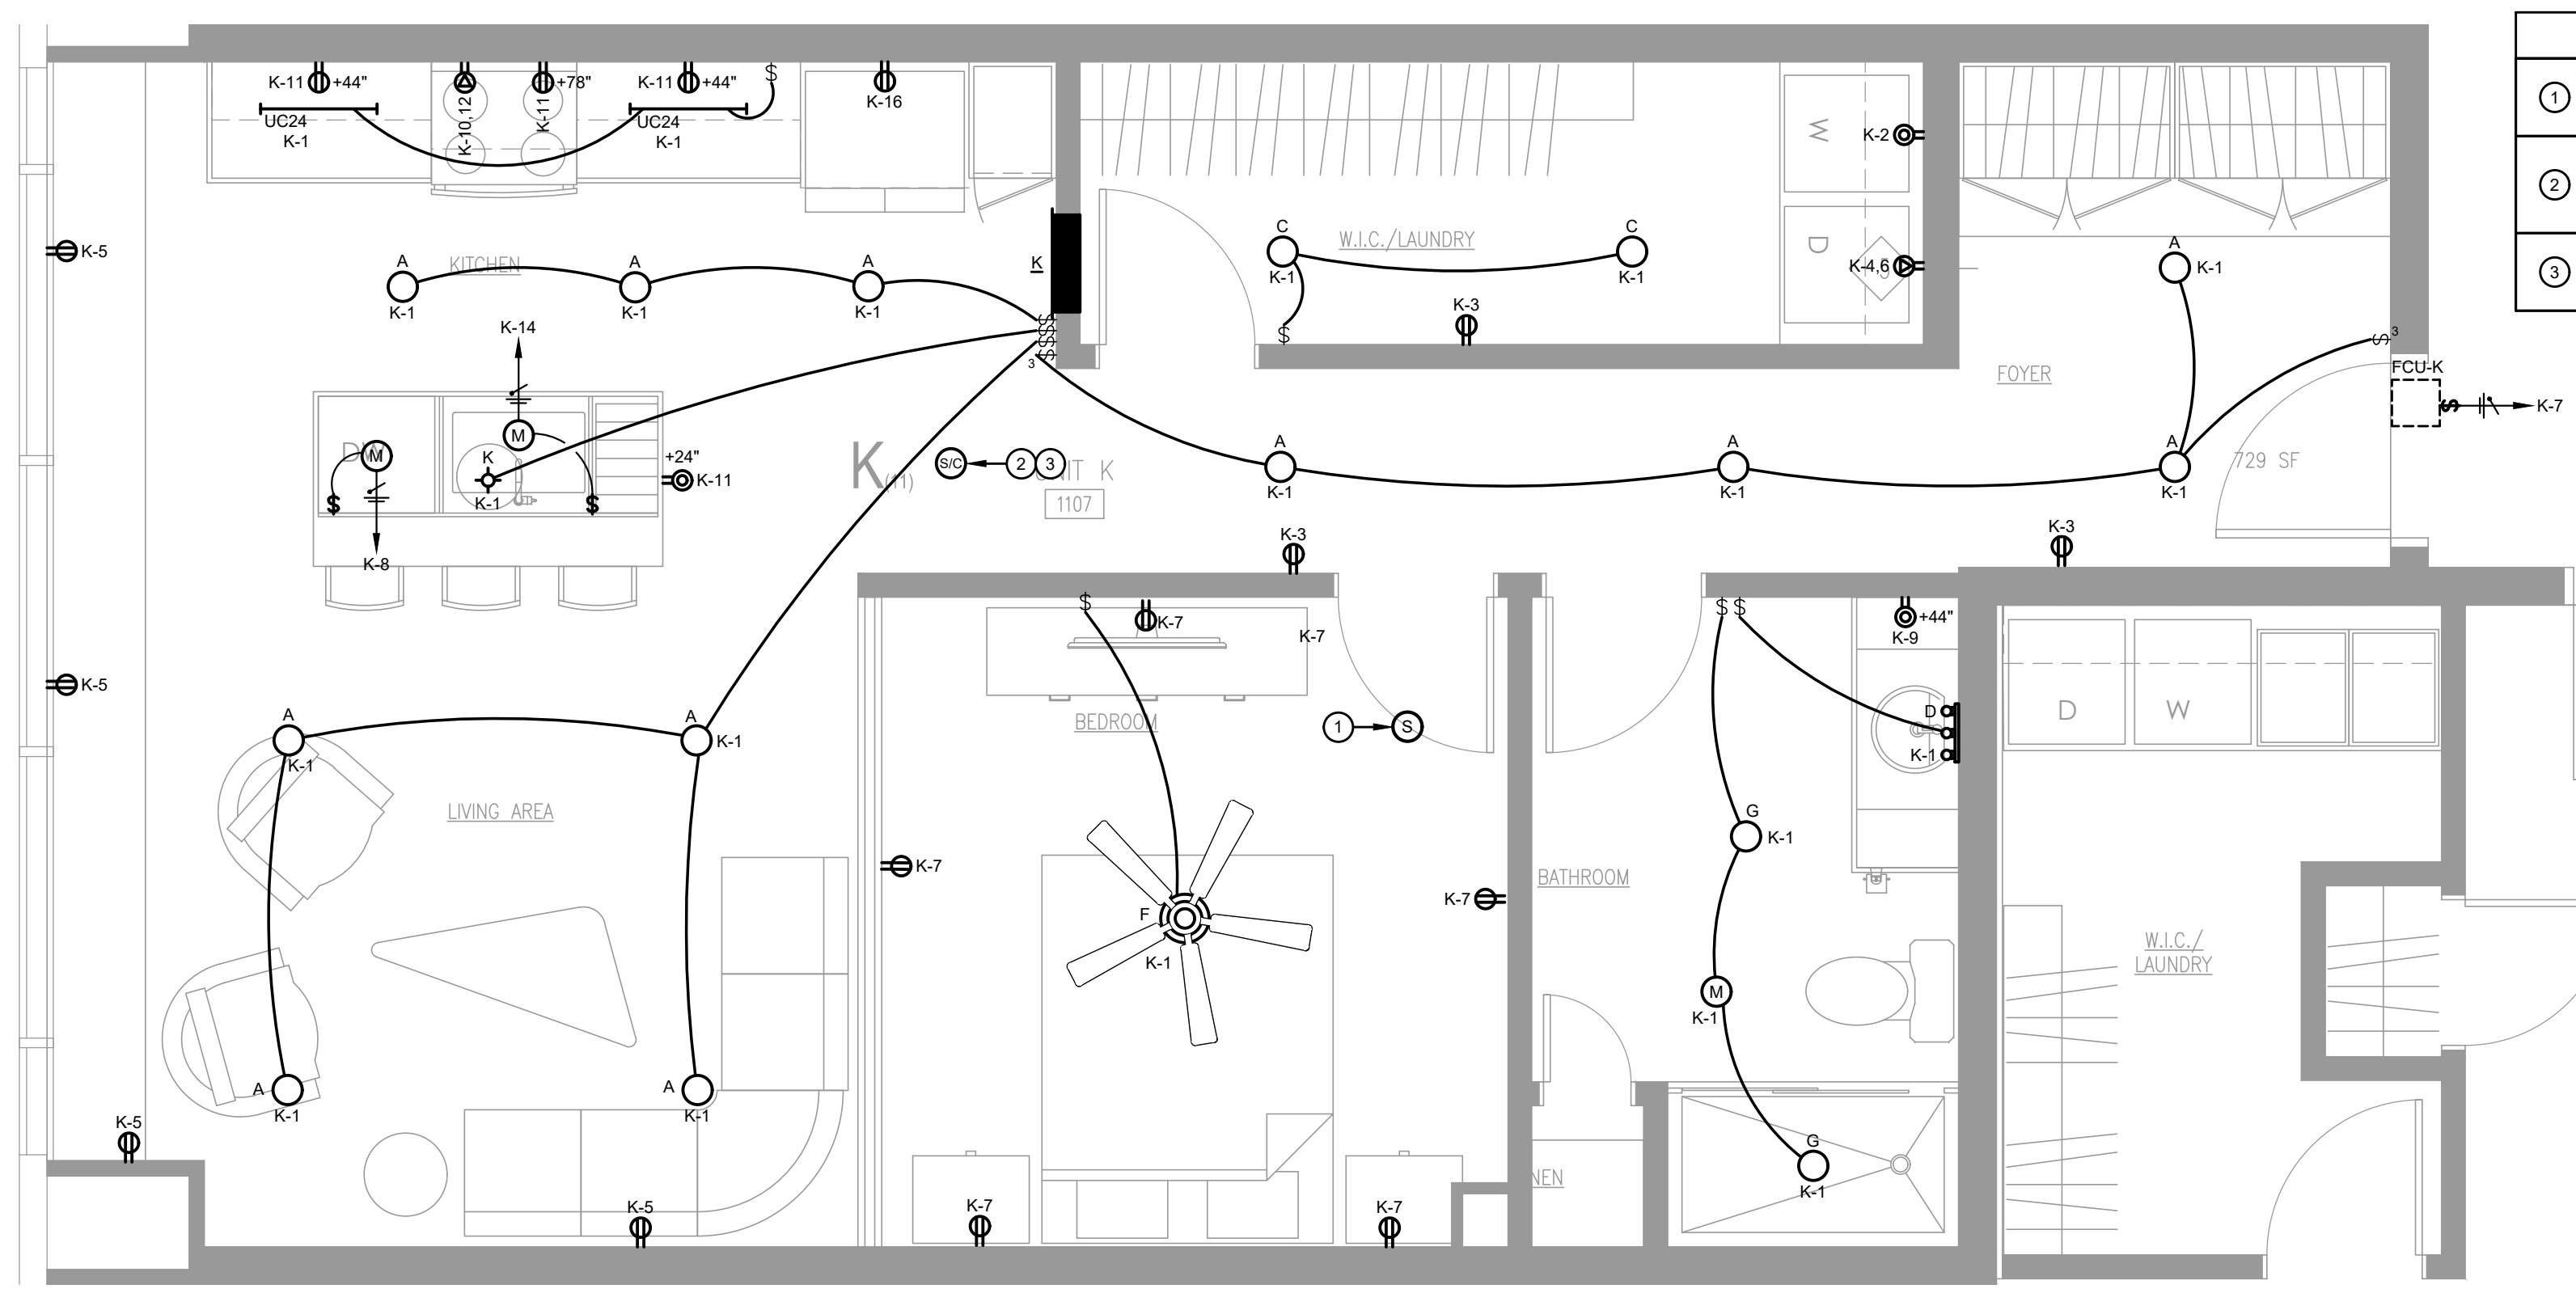

1 TYPICAL UNIT ELECTRICAL PLAN TYPE "K"  
SCALE: 3/8" = 1'-0"

- PLAN NOTES**
- PROVIDE DUAL SENSING (PHOTOELECTRIC AND IONIZATION) SMOKE DETECTOR AT THIS LOCATION. ALL SMOKE DETECTORS SHALL BE 120V HARD WIRED AND INTERCONNECTED WITH BATTERY BACKUP.
  - PROVIDE WITH DUAL SENSING (PHOTOELECTRIC AND IONIZATION) SMOKE DETECTOR WITH CARBON MONOXIDE SENSOR AT THIS LOCATION. ALL SMOKE DETECTORS SHALL BE 120V HARD-WIRED AND INTERCONNECTED WITH BATTERY BACKUP.
  - CONTRACTOR TO INSTALL MULTI-STATION SMOKE DETECTORS AND COMBINATION SMOKE/CARBON MONOXIDE DETECTORS IN ACCORDANCE WITH NFPA 72. TYPICAL OF ALL DEVICES.

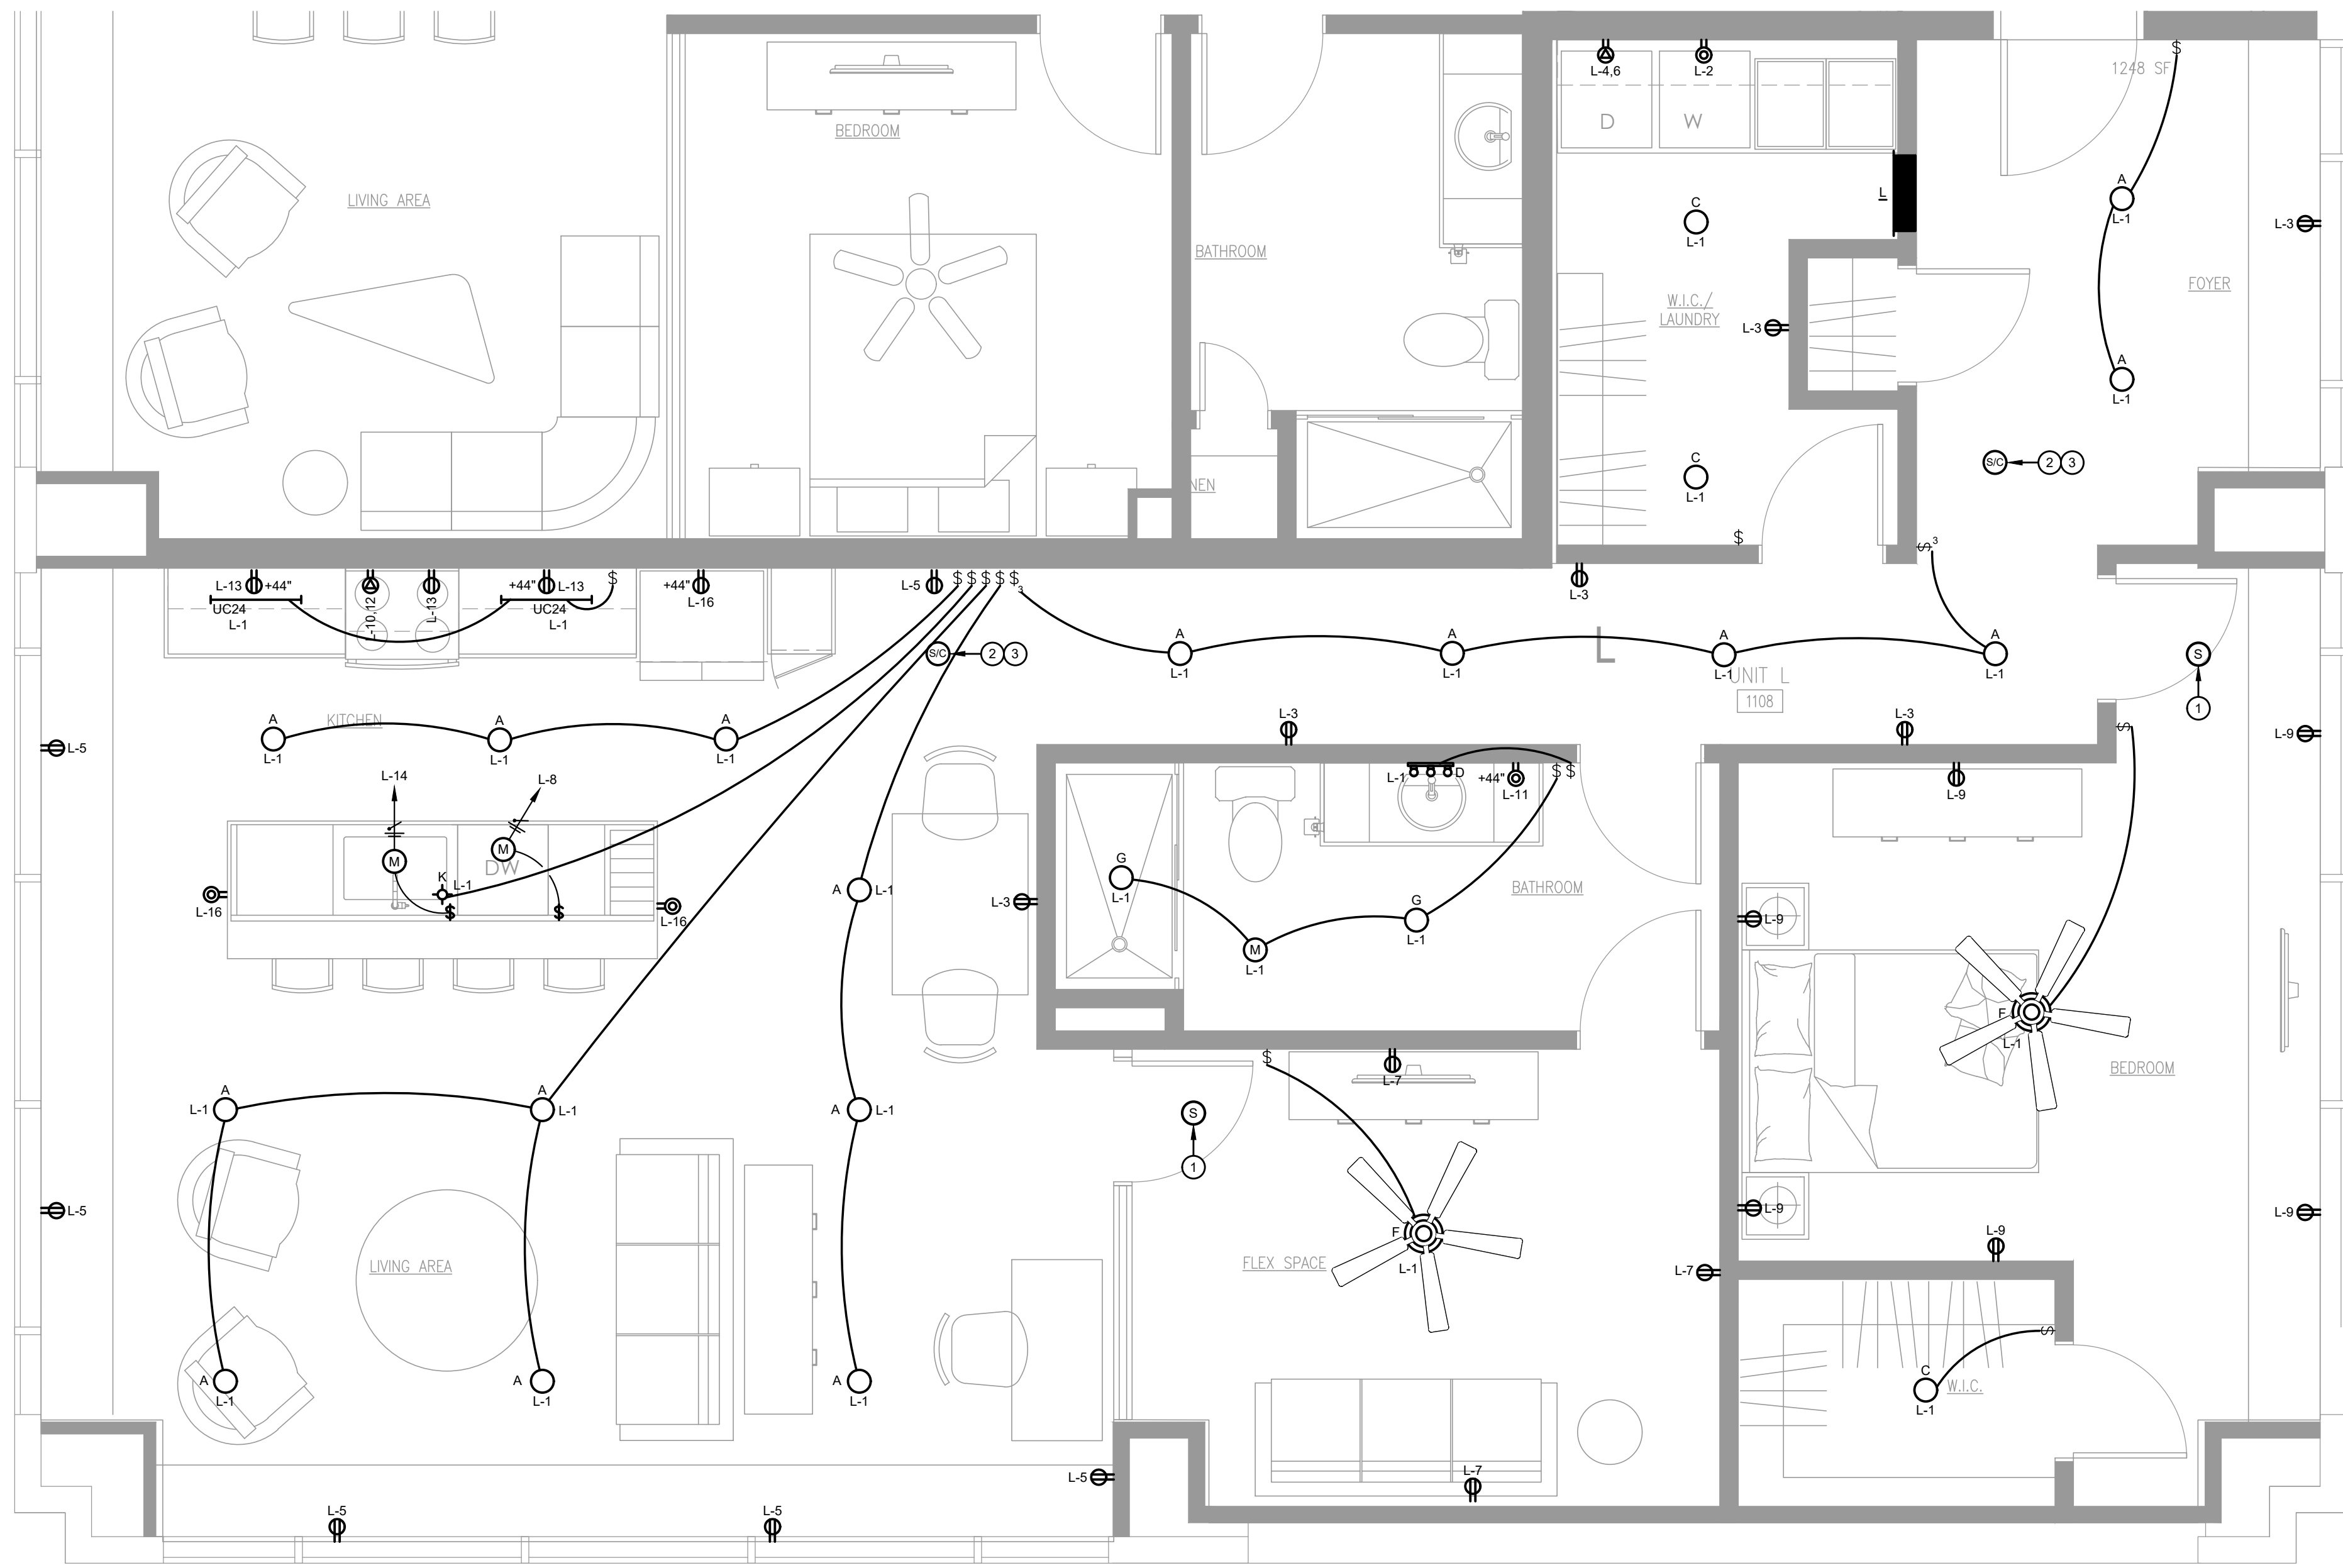

3 TYPICAL UNIT ELECTRICAL PLAN TYPE "L"  
SCALE: 3/8" = 1'-0"

NO.	ISSUED FOR
DATE	


SEAL  
STATE OF OHIO  
LAWRENCE S. AYER  
REGISTERED PROFESSIONAL ENGINEER  
EXPIRATION DATE: 12/31/2023  
*Lawrence S. Ayer*  
SIGNATURE  
DATE

TYPICAL UNIT  
ELECTRIC PLAN


DRAWN BY:	SJG, AGR
CHECKED BY:	SJG
SCALE:	AS NOTED
JOB NUMBER:	57640
START DATE:	11/02/2022

RENDERED BY EIM CO-OP ON Tuesday, August 22, 2023 9:26:32 AM. FILE LOCATION: Y:\0 PROJECTS\CURRENT\2022\MOEL GROUP\MERCANTILE LIBRARY\WORKING FILES\FORMICA BUILDINGS\RETS-E1.13.DWG

- PLAN NOTES**
- 1 PROVIDE DUAL SENSING (PHOTOELECTRIC AND IONIZATION) SMOKE DETECTOR AT THIS LOCATION. ALL SMOKE DETECTORS SHALL BE 120V HARD WIRED AND INTERCONNECTED WITH BATTERY BACKUP.
  - 2 PROVIDE WITH DUAL SENSING (PHOTOELECTRIC AND IONIZATION) SMOKE DETECTOR WITH CARBON MONOXIDE SENSOR AT THIS LOCATION. ALL SMOKE DETECTORS SHALL BE 120V HARD-WIRED AND INTERCONNECTED WITH BATTERY BACKUP.
  - 3 CONTRACTOR TO INSTALL MULTI-STATION SMOKE DETECTORS AND COMBINATION SMOKE/CARBON MONOXIDE DETECTORS IN ACCORDANCE WITH NFPA 72. TYPICAL OF ALL DEVICES.

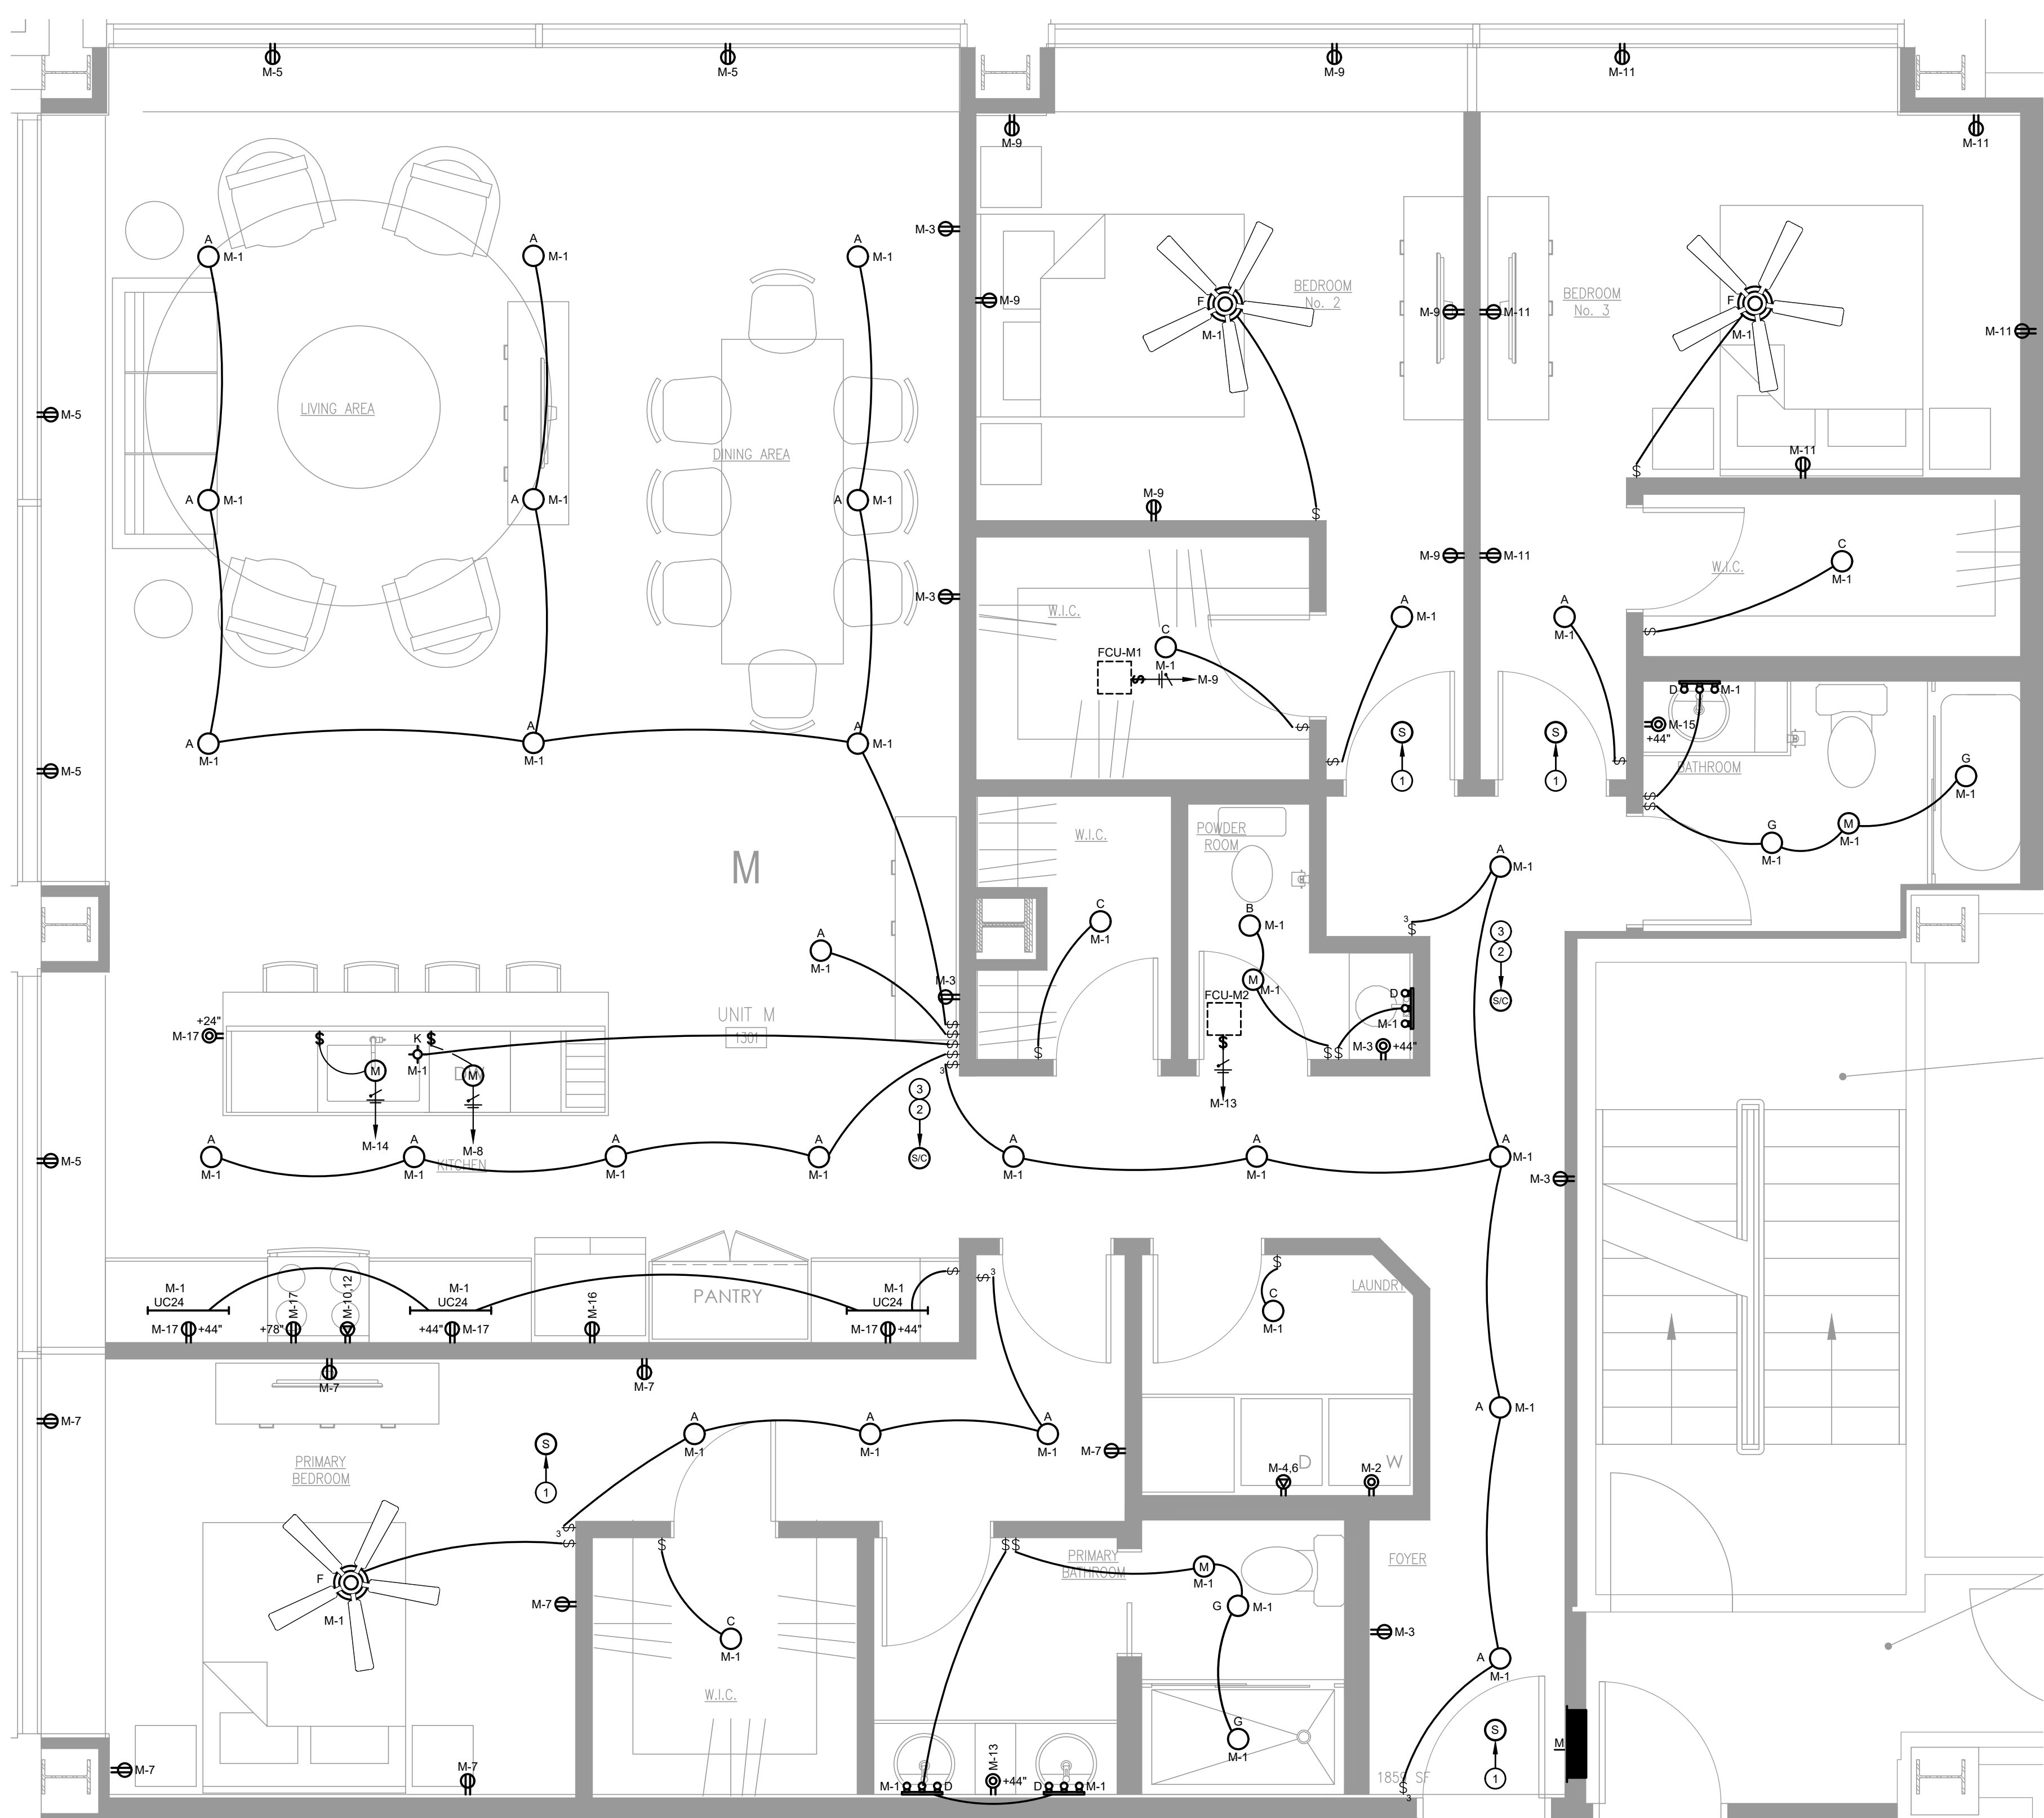

2 TYPICAL UNIT ELECTRICAL PLAN TYPE "M"  
 SCALE: 3/8" = 1'-0"

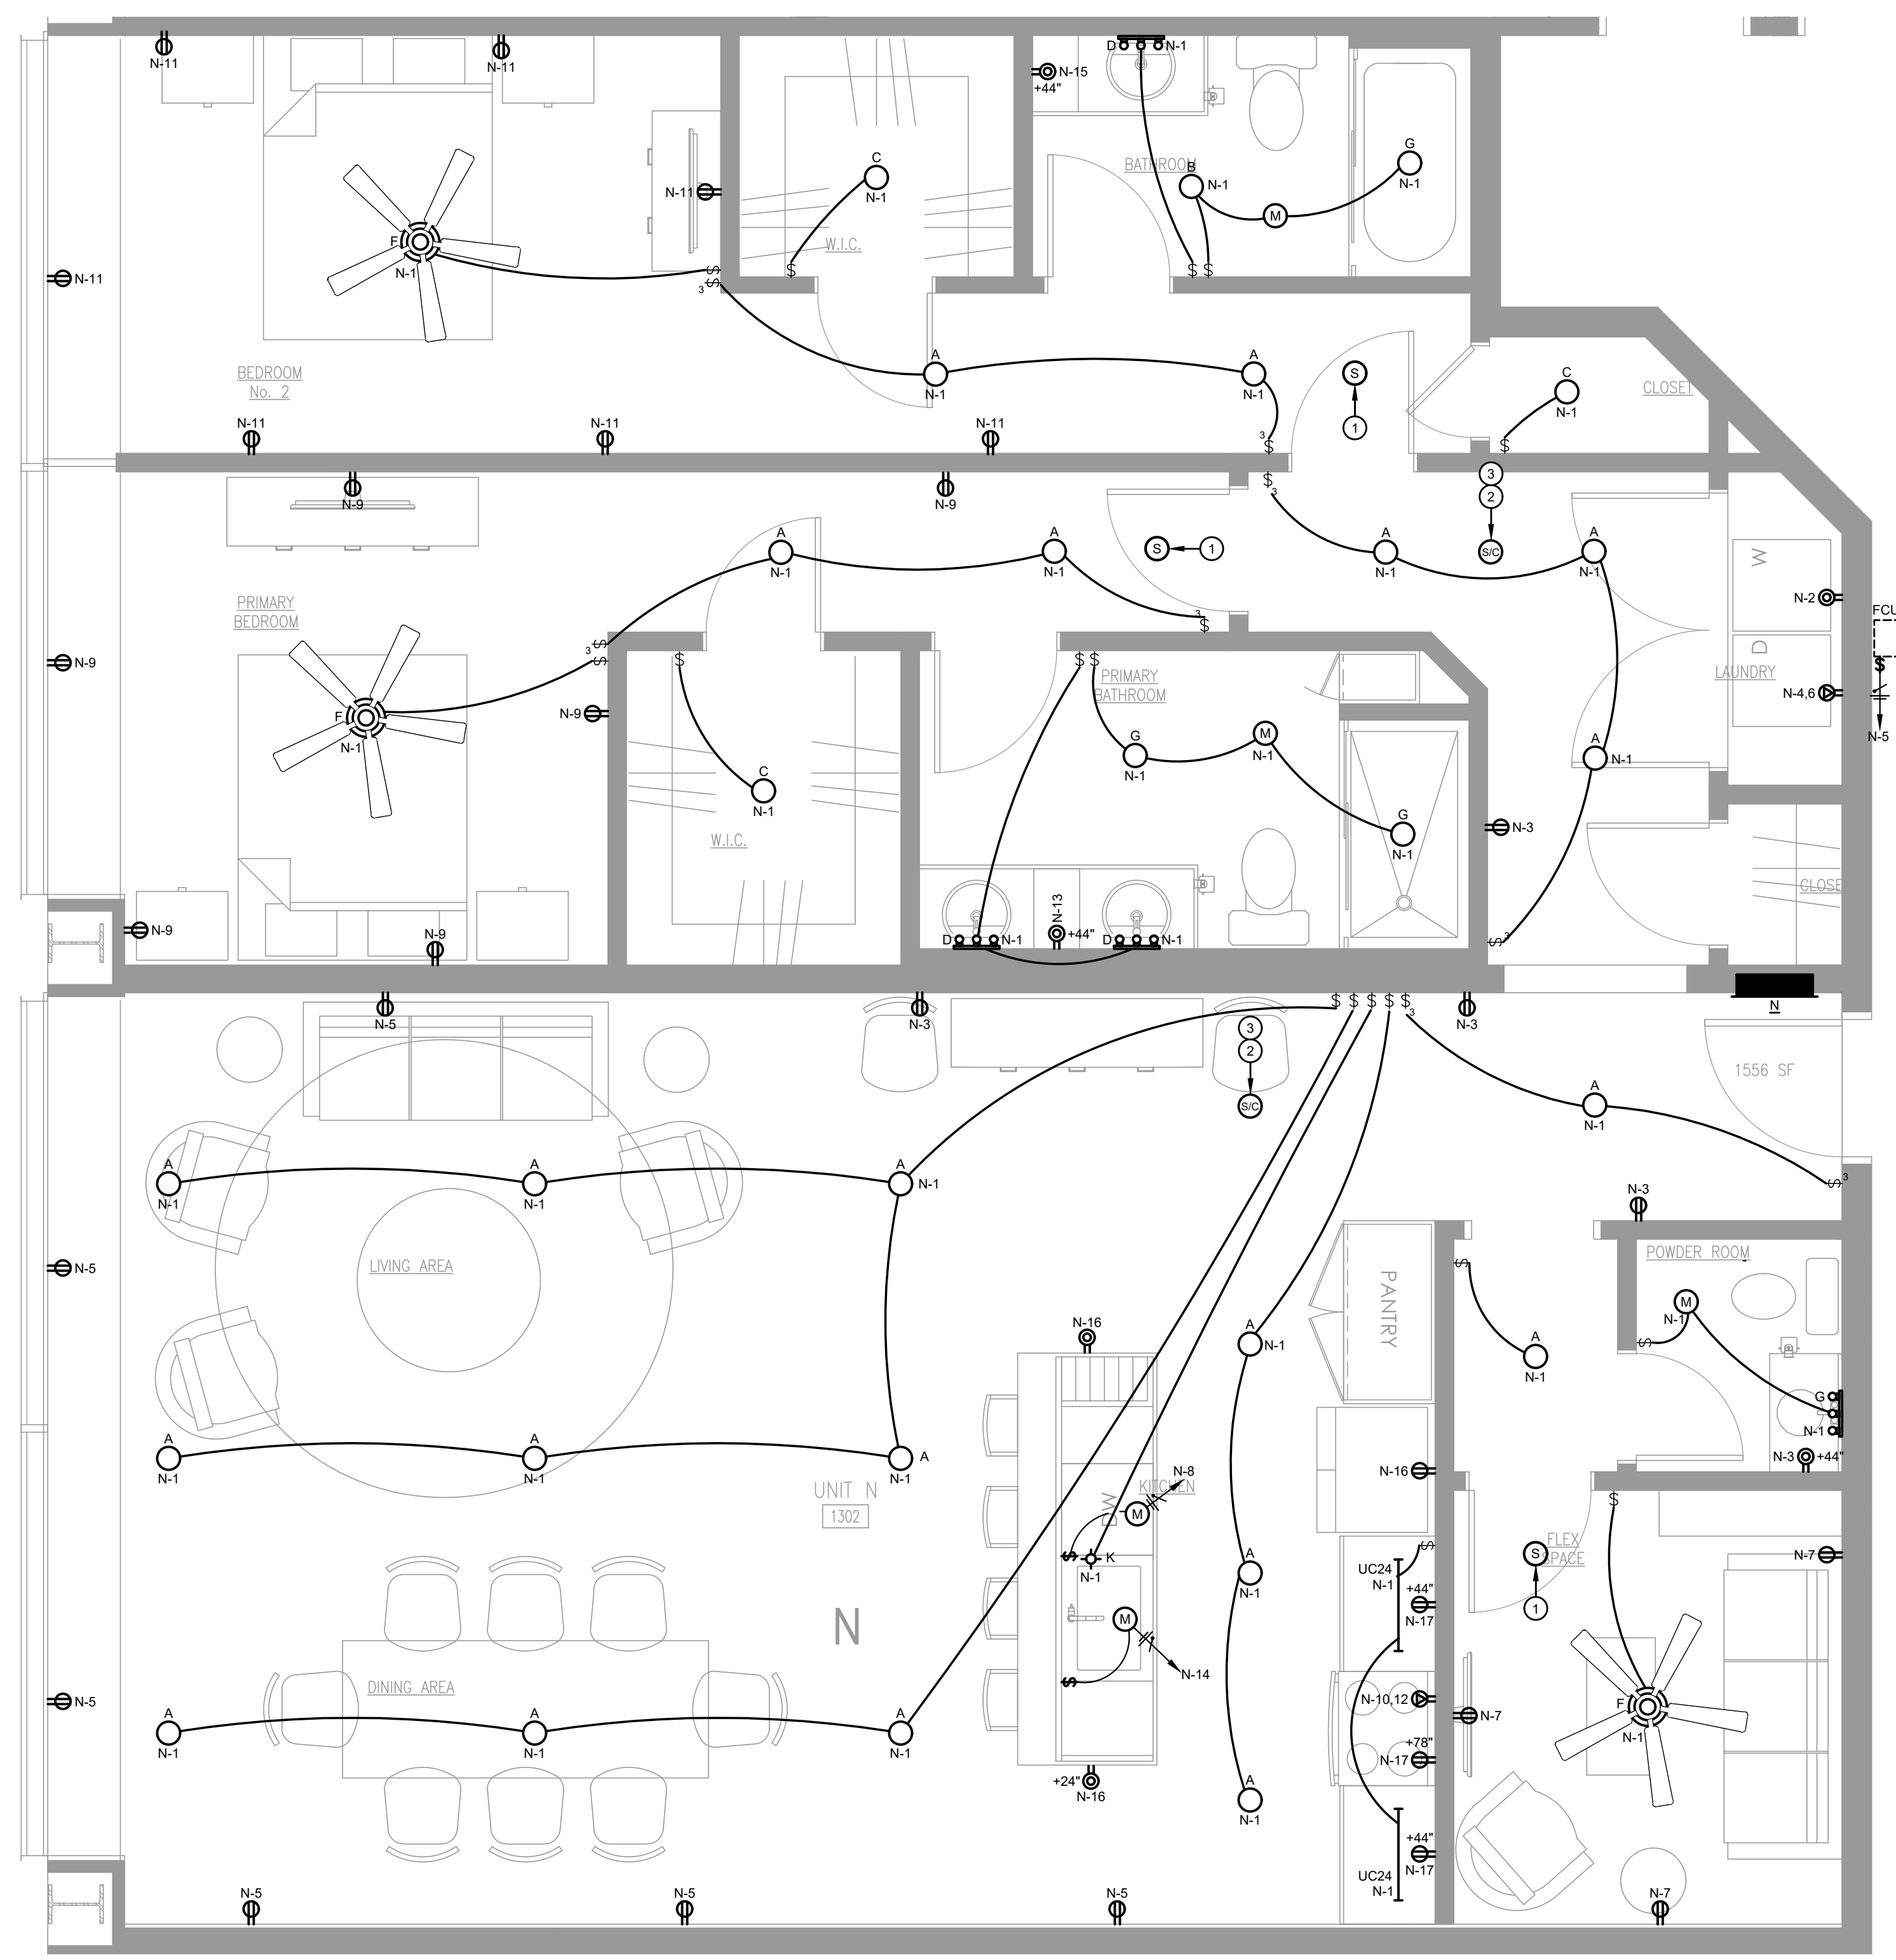

TYPICAL UNIT ELECTRICAL PLAN TYPE "N"  
 SCALE: 3/8" = 1'-0"

INTERIOR ALTERATIONS  
 FOR  
**FORMICA**  
 414 WALNUT STREET  
 CINCINNATI, OH 45202

NO.	ISSUED FOR
DATE	

SEAL

*Sam S. Agre*  
 SIGNATURE



DATE

TYPICAL UNIT  
 ELECTRIC PLAN

DRAWN BY: S.J.G. AGR  
 CHECKED BY: S.J.G.  
 SCALE: AS NOTED  
 JOB NUMBER: 57640  
 START DATE: 11/02/2022

PLotted by EDM CO-OP on Tuesday, August 22, 2023 9:28:45 AM. FILE LOCATION: Y:\0 PROJECTS\CURRENT 2023\MODEL GROUP\BENTLEY LIBRARY\WORKING FILES\FORMICA BUILDINGS\19-4114.DWG

PLAN NOTES	
1	PROVIDE DUAL SENSING (PHOTOELECTRIC AND IONIZATION) SMOKE DETECTOR AT THIS LOCATION. ALL SMOKE DETECTORS SHALL BE 120V HARD WIRED AND INTERCONNECTED WITH BATTERY BACKUP.
2	PROVIDE WITH DUAL SENSING (PHOTOELECTRIC AND IONIZATION) SMOKE DETECTOR WITH CARBON MONOXIDE SENSOR AT THIS LOCATION. ALL SMOKE DETECTORS SHALL BE 120V HARD-WIRED AND INTERCONNECTED WITH BATTERY BACKUP.
3	CONTRACTOR TO INSTALL MULTI-STATION SMOKE DETECTORS AND COMBINATION SMOKE/CARBON MONOXIDE DETECTORS IN ACCORDANCE WITH NFPA 72. TYPICAL OF ALL DEVICES.

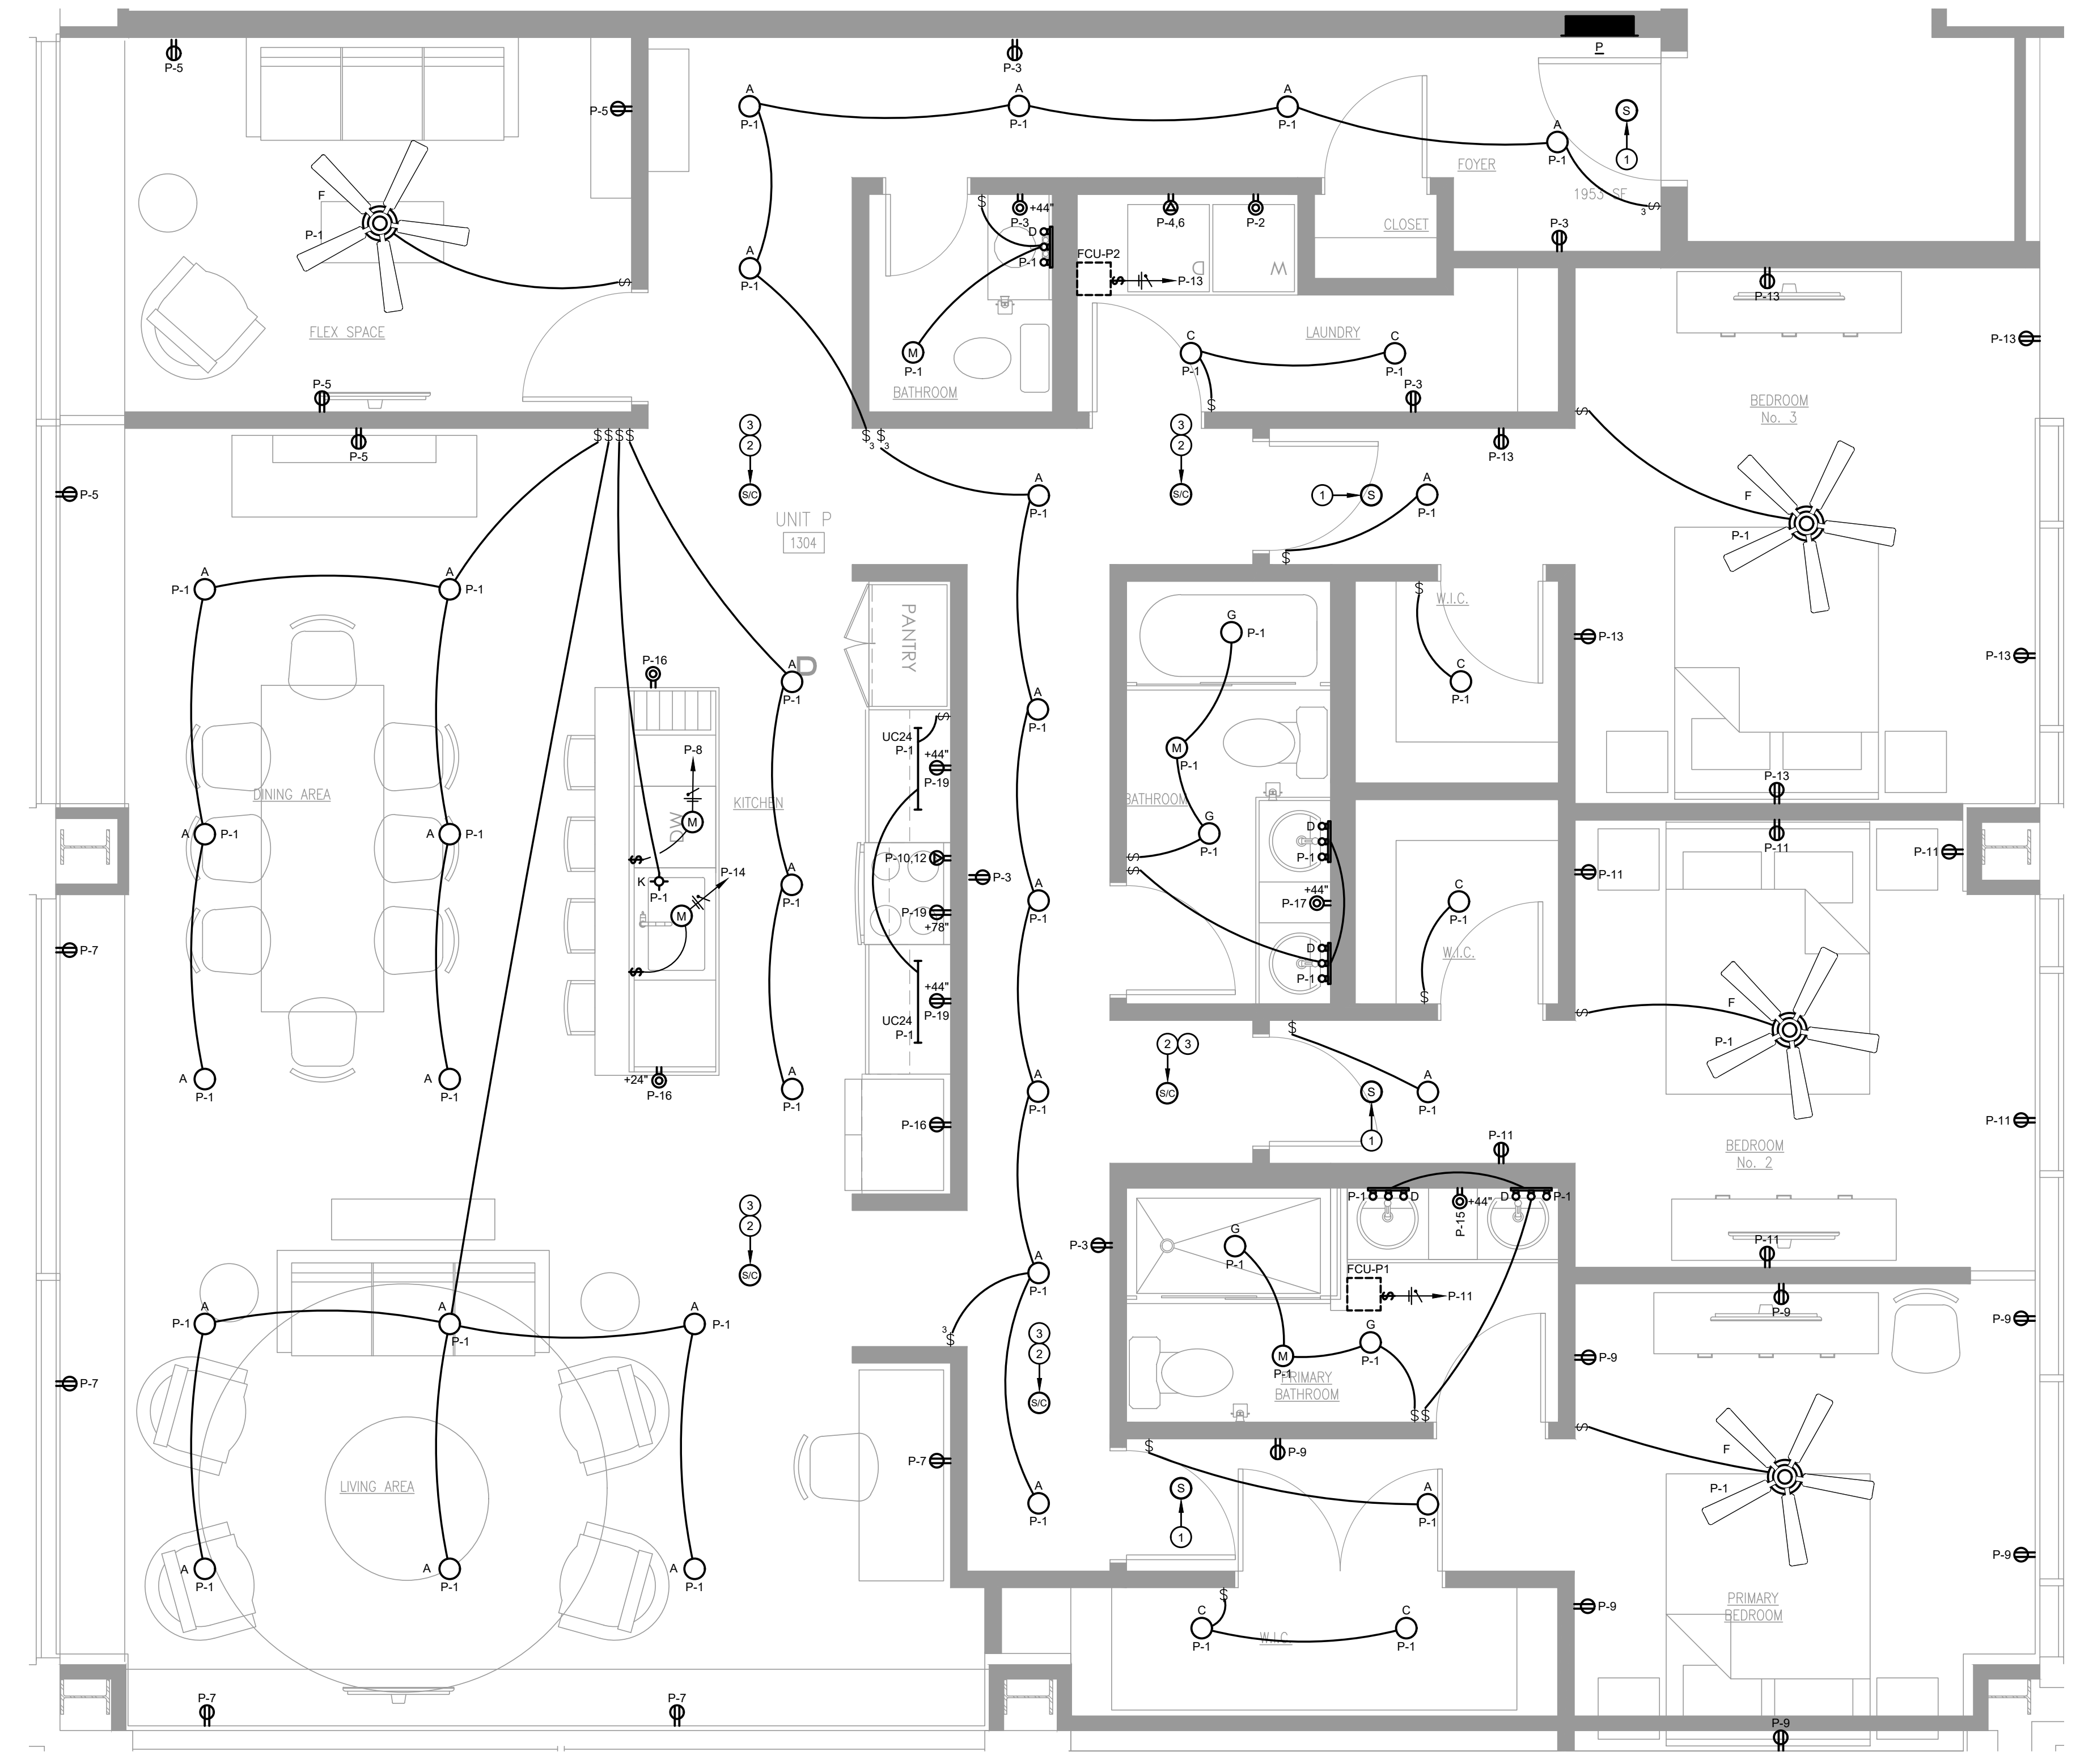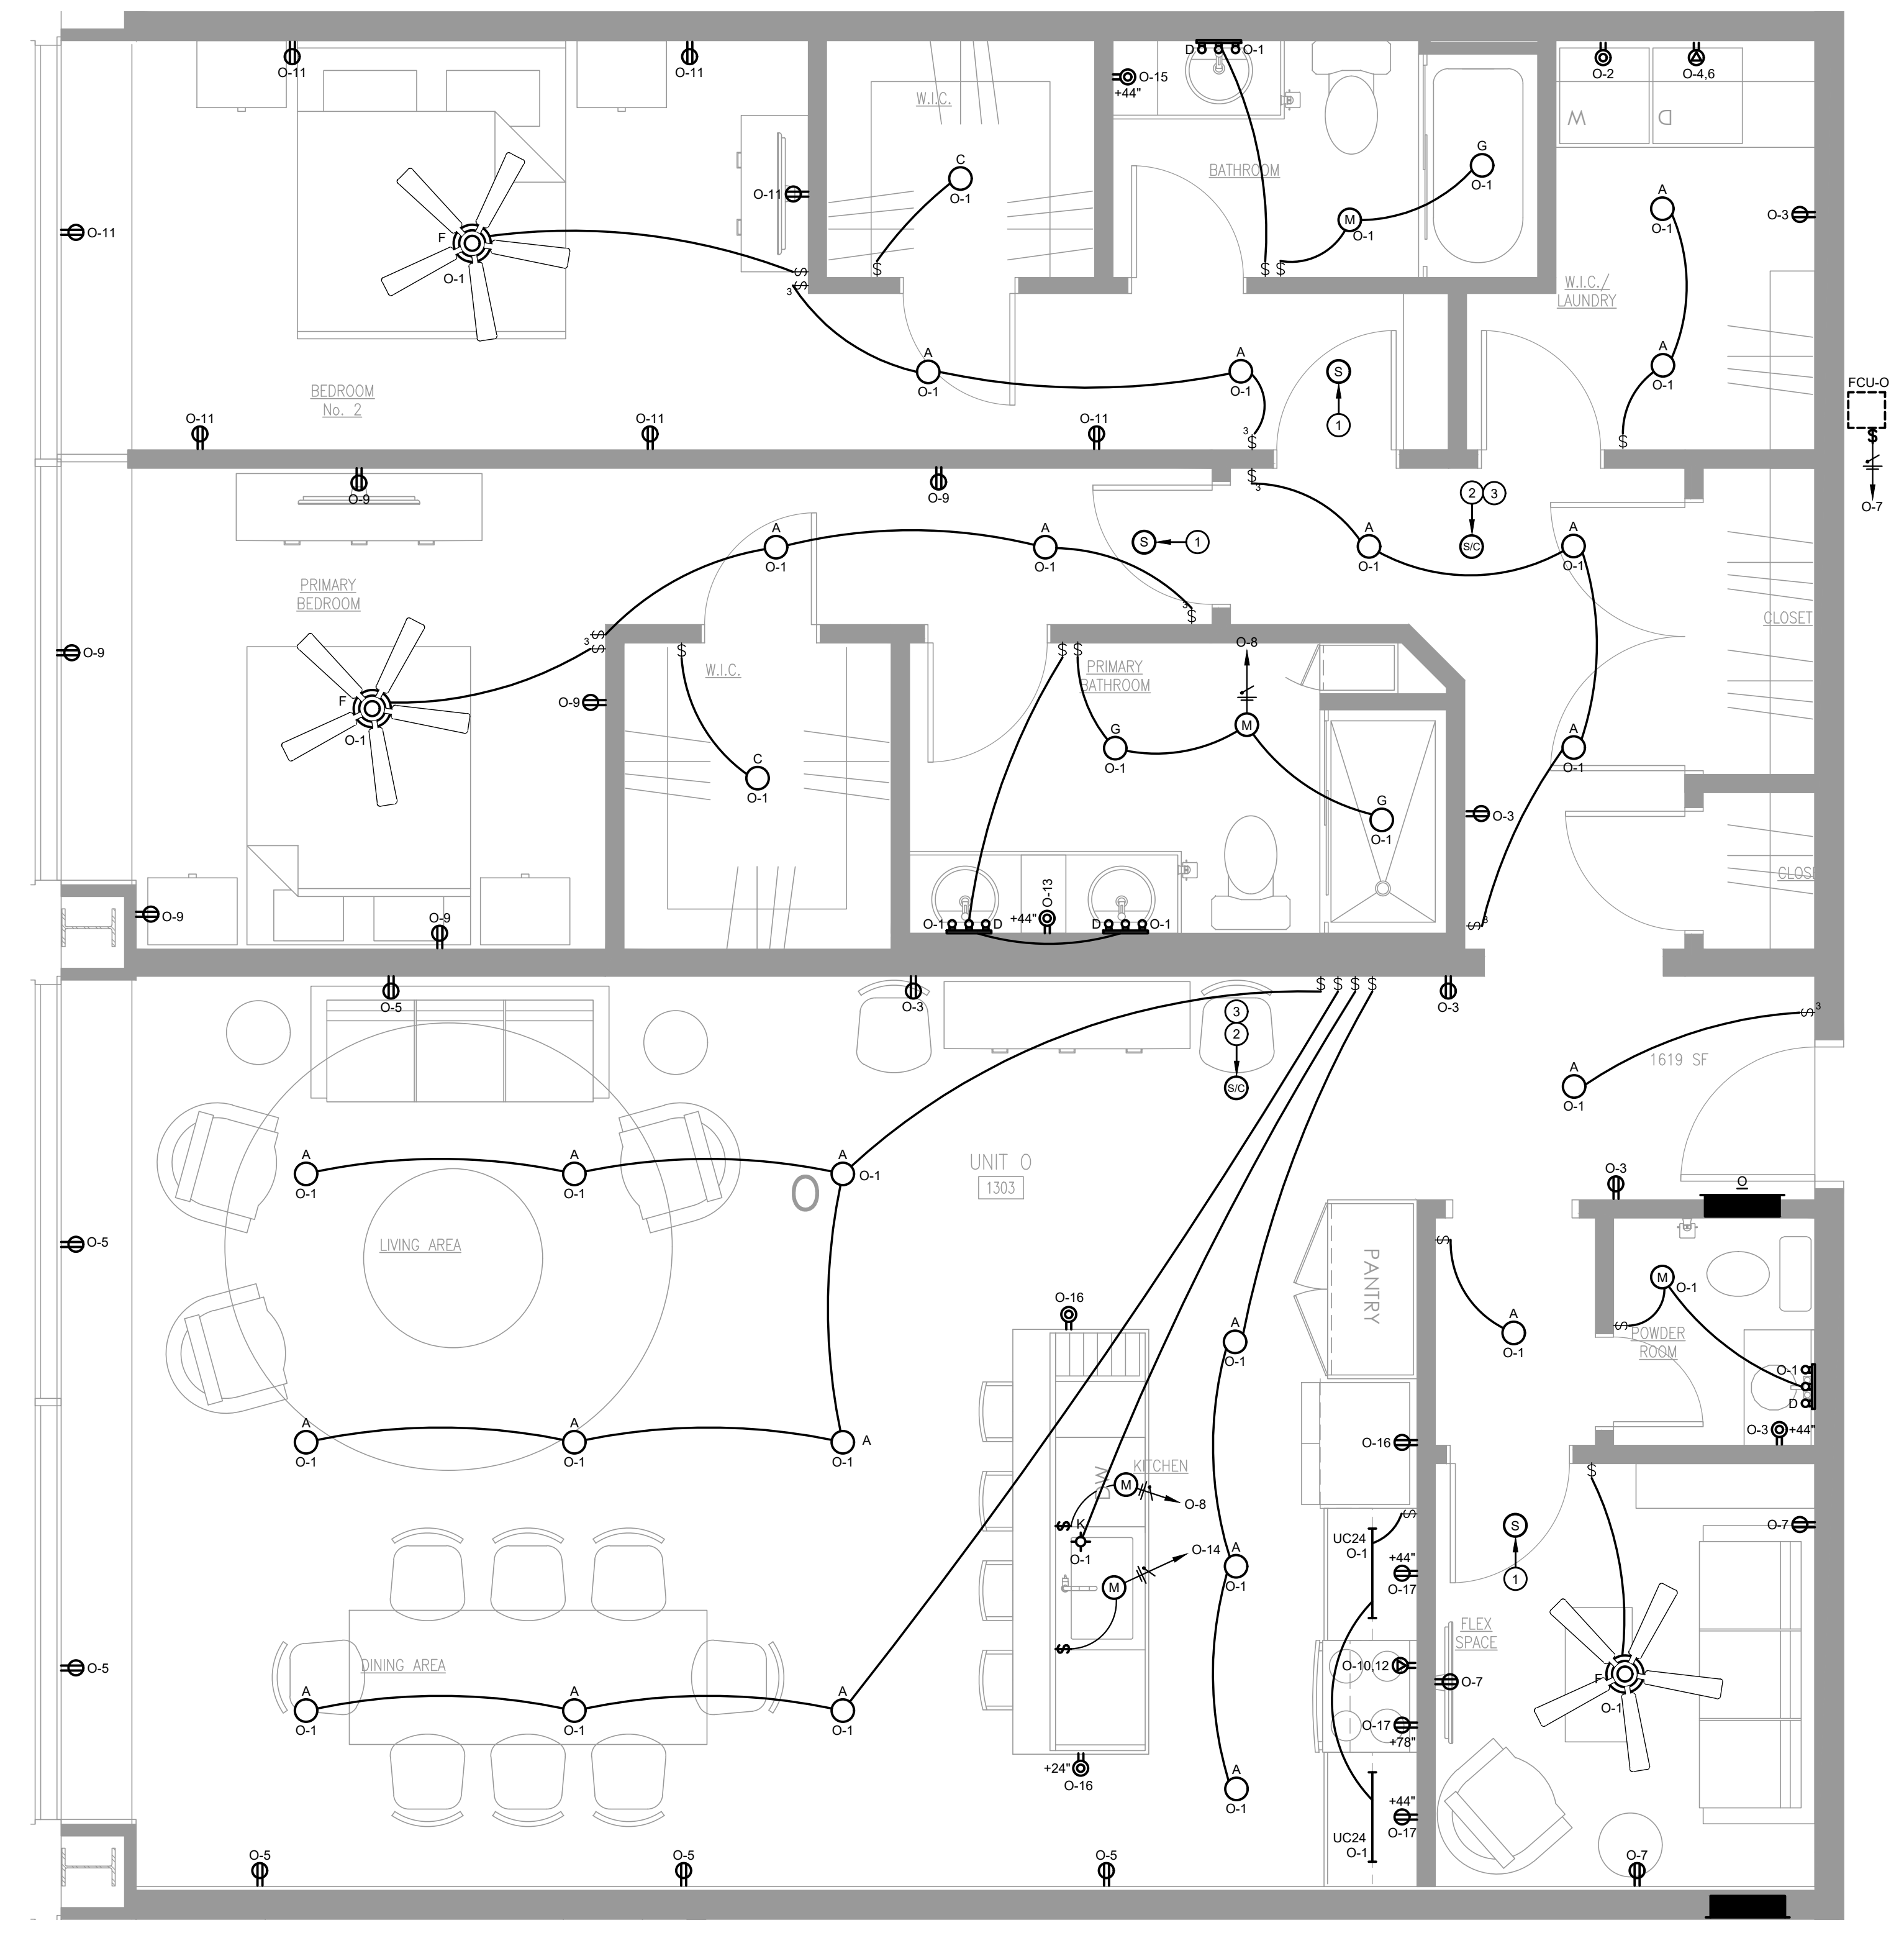

INTERIOR ALTERATIONS  
 FOR  
**FORMICA**  
 414 WALNUT STREET  
 CINCINNATI, OH 45202

NO.	DATE	ISSUED FOR

SEAL

*Sam S. Agre*  
 SIGNATURE

DATE

TYPICAL UNIT  
 ELECTRIC PLAN

DRAWN BY: SJG, AGR  
 CHECKED BY: SJG  
 SCALE: AS NOTED  
 JOB NUMBER: 57640  
 START DATE: 11/02/2022

PLOTTED BY EJM CO-OP/PT ON Tuesday, August 22, 2023 9:28:39 AM. FILE LOCATION: Y:\0 PROJECTS\CURRENT\2022\MOEL GROUP\MERCANTILE LIBRARY\WORKING FLESH\FORMICA BUILDINGS\ETS-E1.15.DWG